
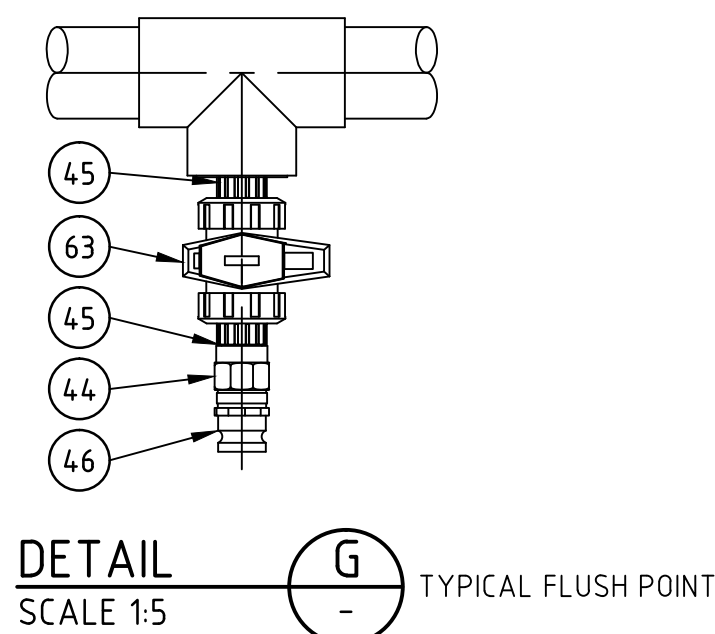
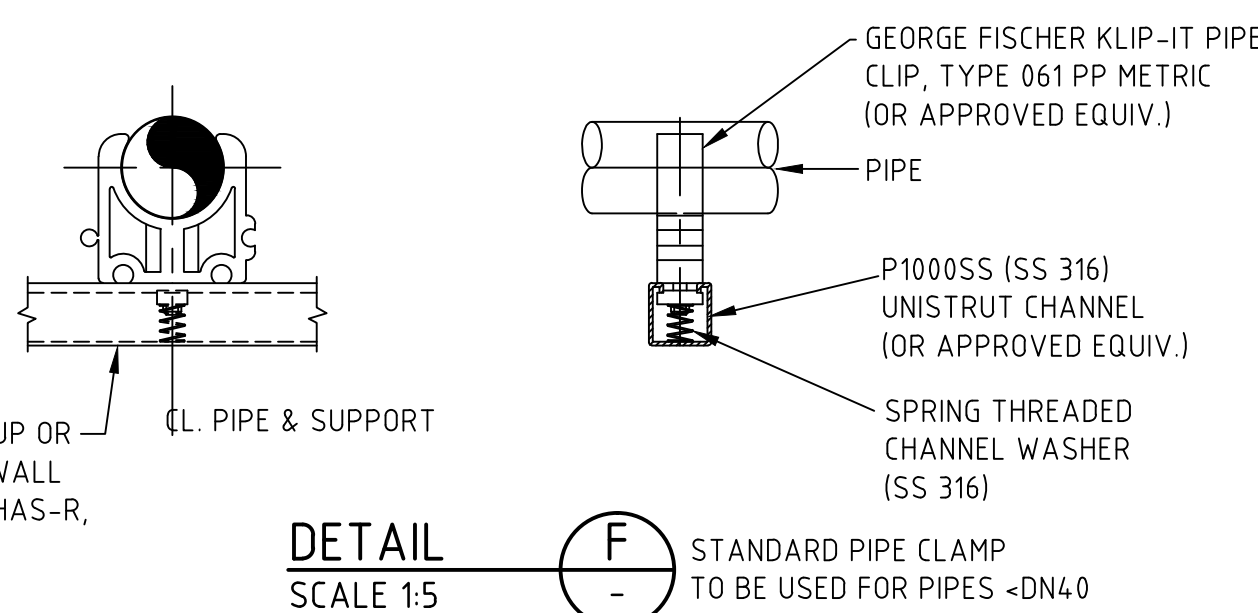
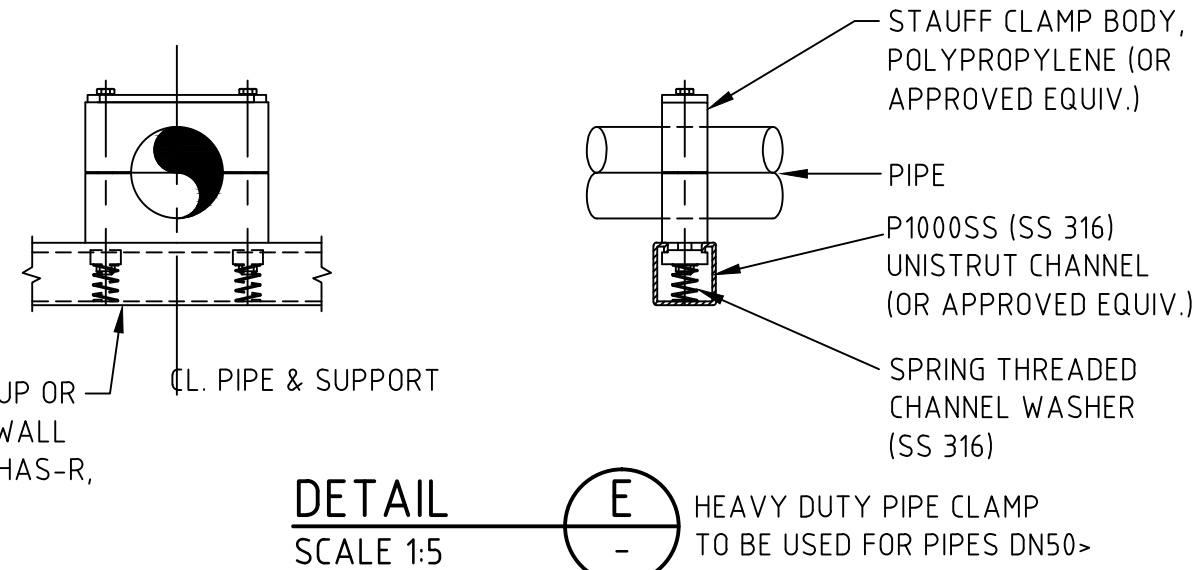
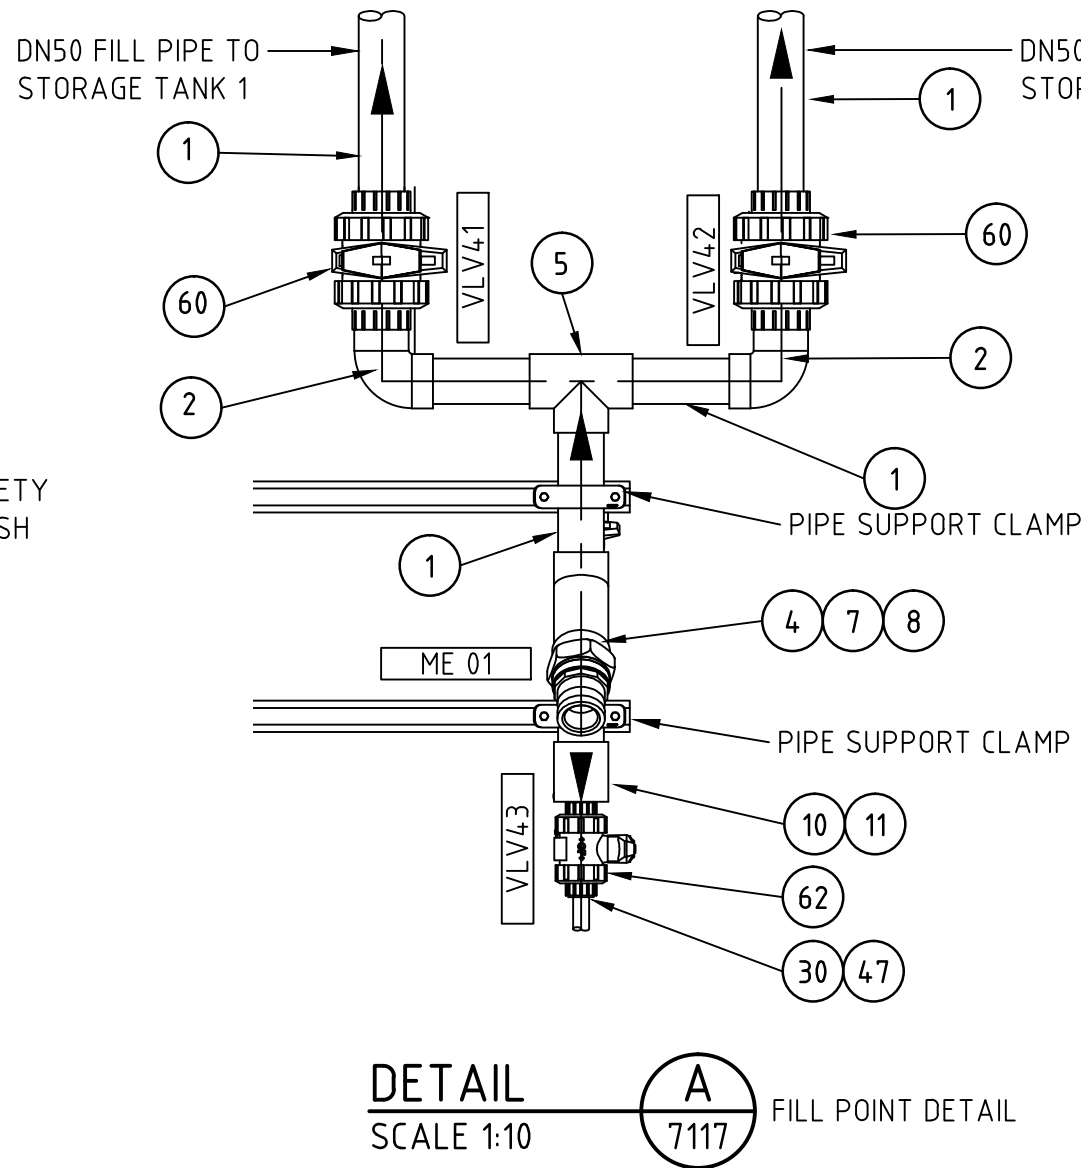
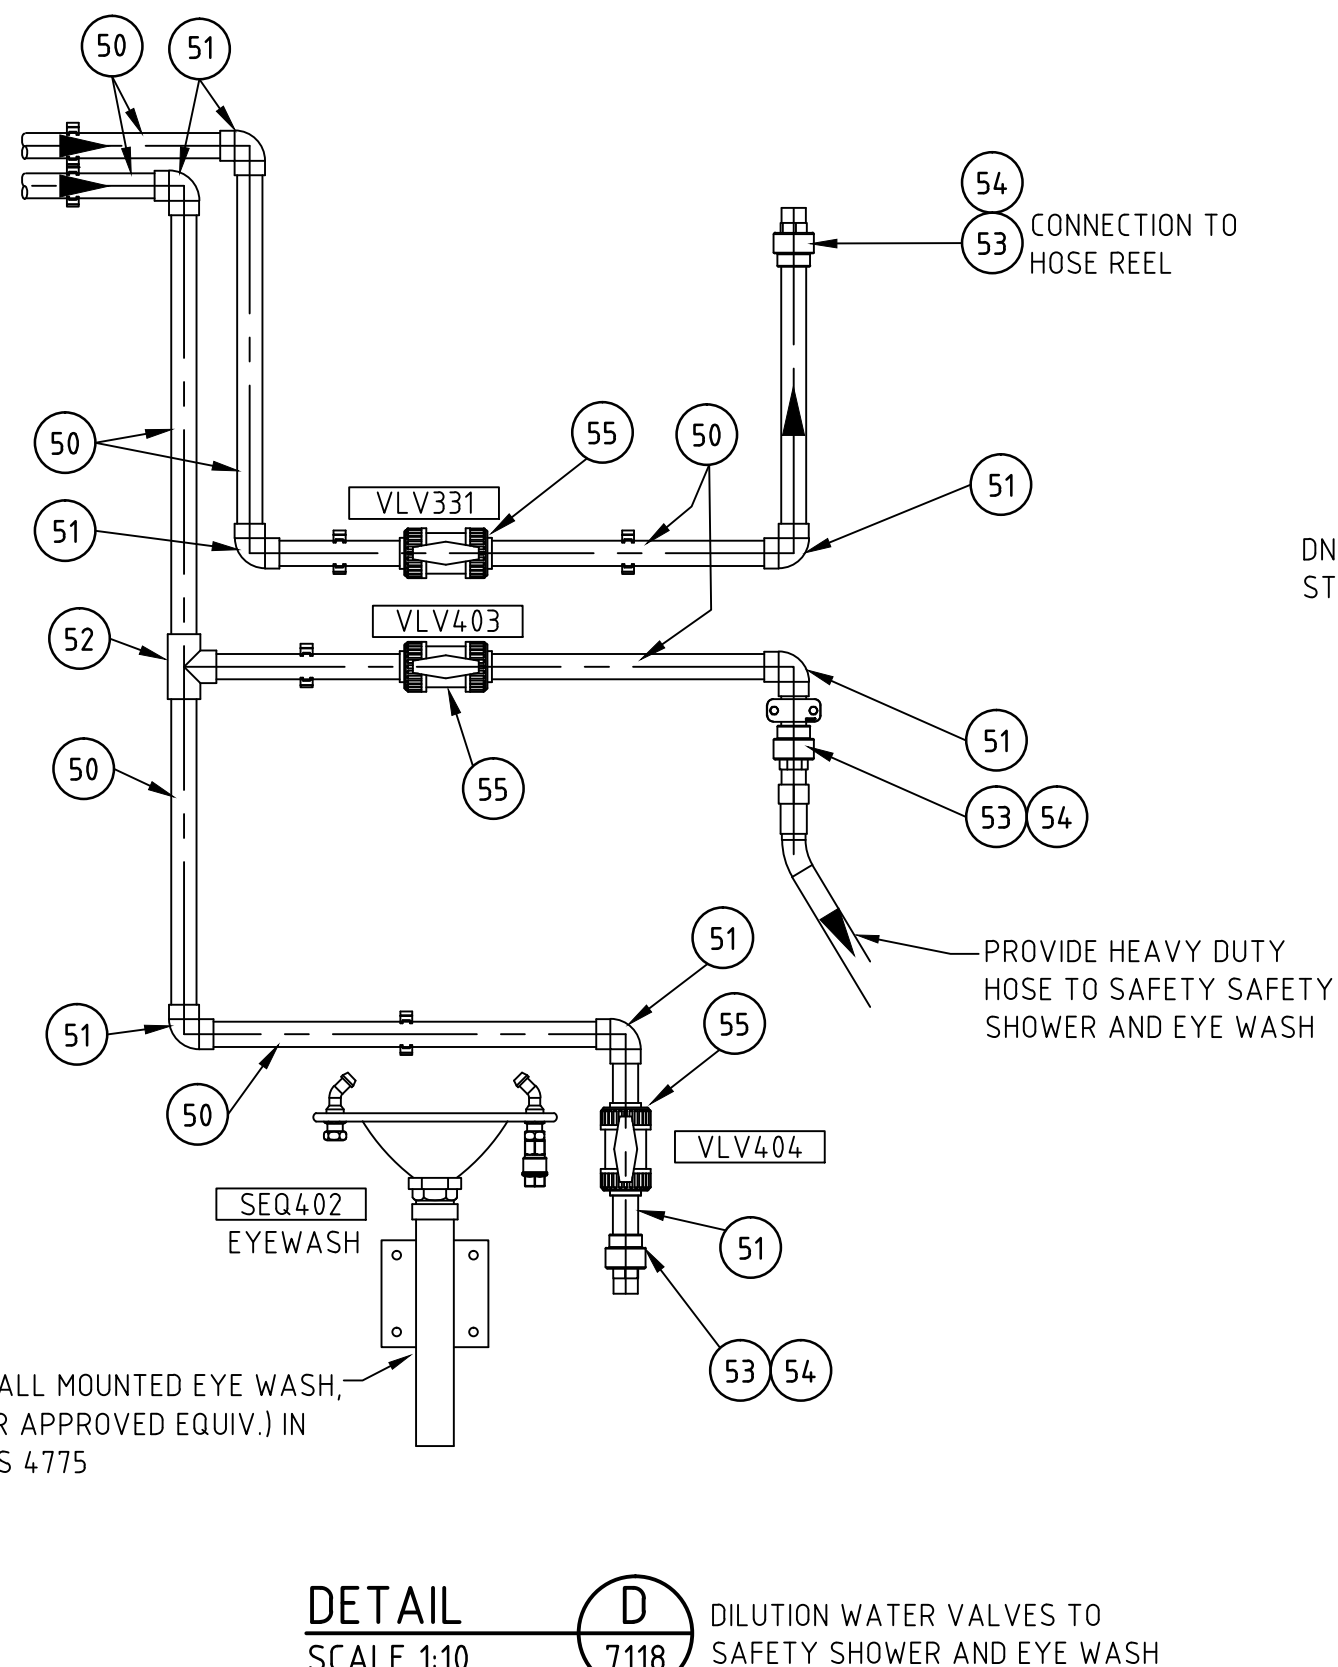
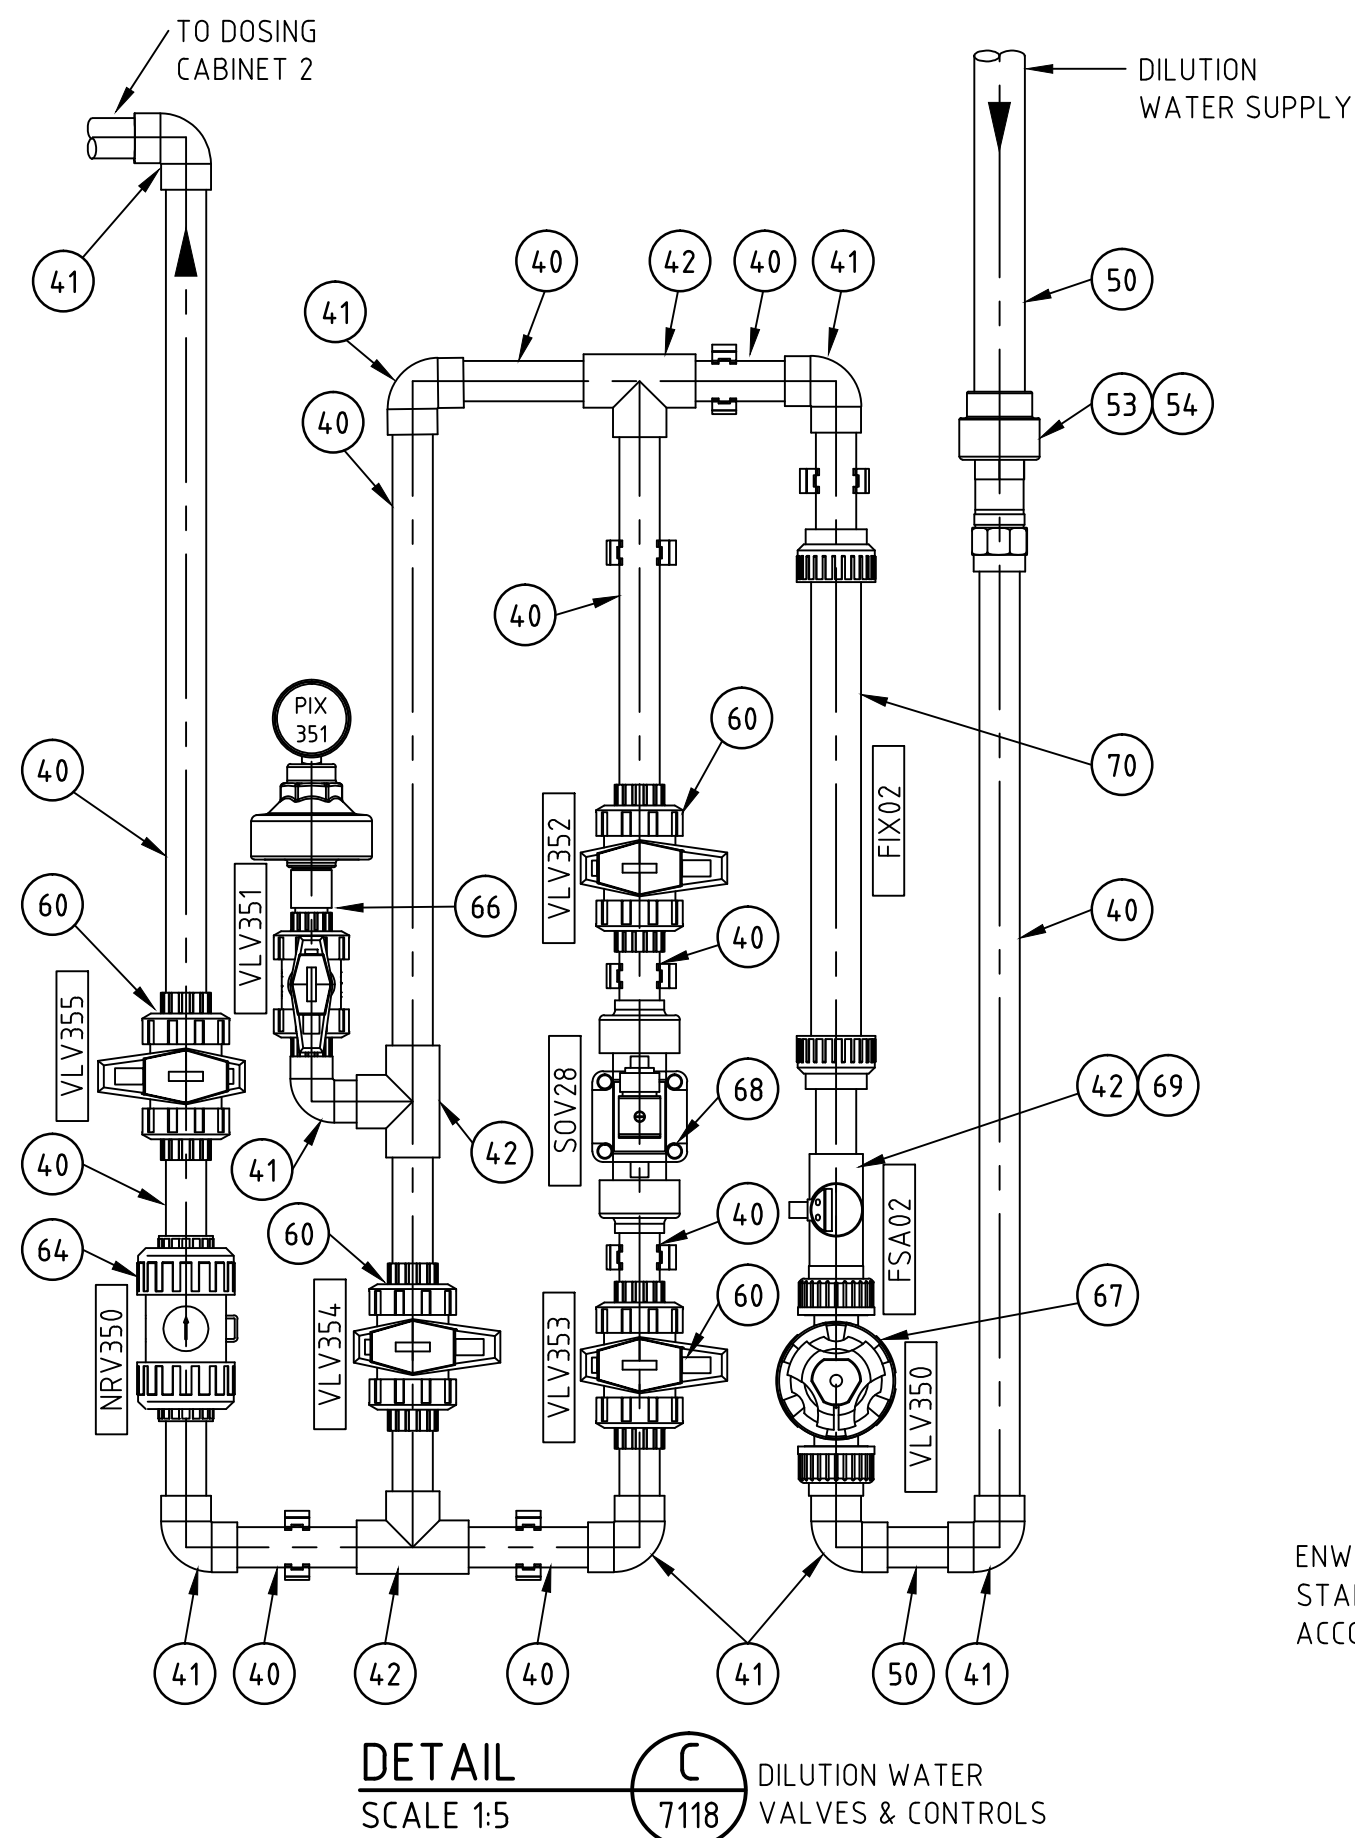


NOTES:

1. FOR GENERAL NOTES REFER TO DRG No. DTC-7002.
2. MOTORISED VALVE TO BE DRIVEN BY BATTERY PACK DURING POWER FAILURE. BATTERIES SHALL NOT BE ATTACHED DIRECTLY TO VALVE.

THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS. USE THIS DRAWING WITH CARE. YOU ARE RESPONSIBLE TO APPLY THE WORK SHOWN IN THIS DRAWING CORRECTLY IN THE CIRCUMSTANCES OF YOUR PROJECT. YOU MUST ENSURE THE WORK IS FIT FOR PURPOSE AND WILL PERFORM ITS INTENDED FUNCTION AS REQUIRED.

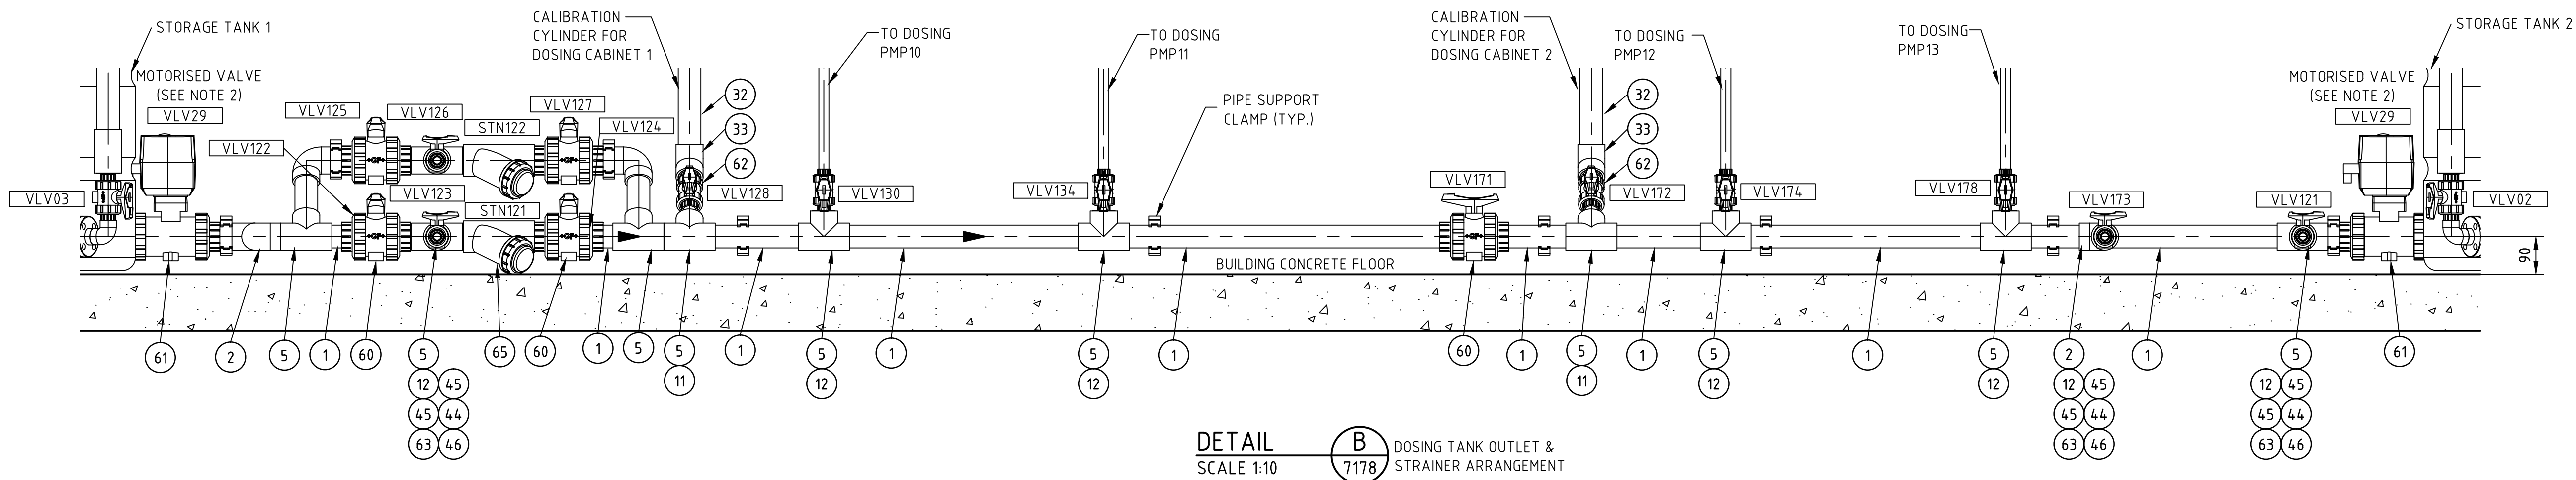

(LABELS SHOWN CORRESPOND FOR DOSING CABINET 2 DILUTION WATER SUPPLY. FOR DOSING CABINET 1 DILUTION WATER LABELS SEE P&ID DTC-7116)

Sydney  
**WATER**

© COPYRIGHT  
STATE OF NEW SOUTH WALES THROUGH SYDNEY  
WATER CORPORATION. ALL RIGHTS RESERVED

APPROVED

MAR 2017

KEN WIGGINS  
MANAGER, E & ES

ENGINEERING & ENVIRONMENTAL SERVICES

LETTER

A ORIGINAL ISSUE

DETAILS OF AMENDMENT

KW

10/03/17

APP'D

DATE

DEEMED TO COMPLY DRAWINGS

**13.5kL + 13.5kL CHEMICAL DOSING UNIT  
FERROUS/FERRIC CHLORIDE & CALCIUM NITRATE  
PIPEWORK DETAILS - SHEET 2 OF 2**

**DTC  
7120**