


A1

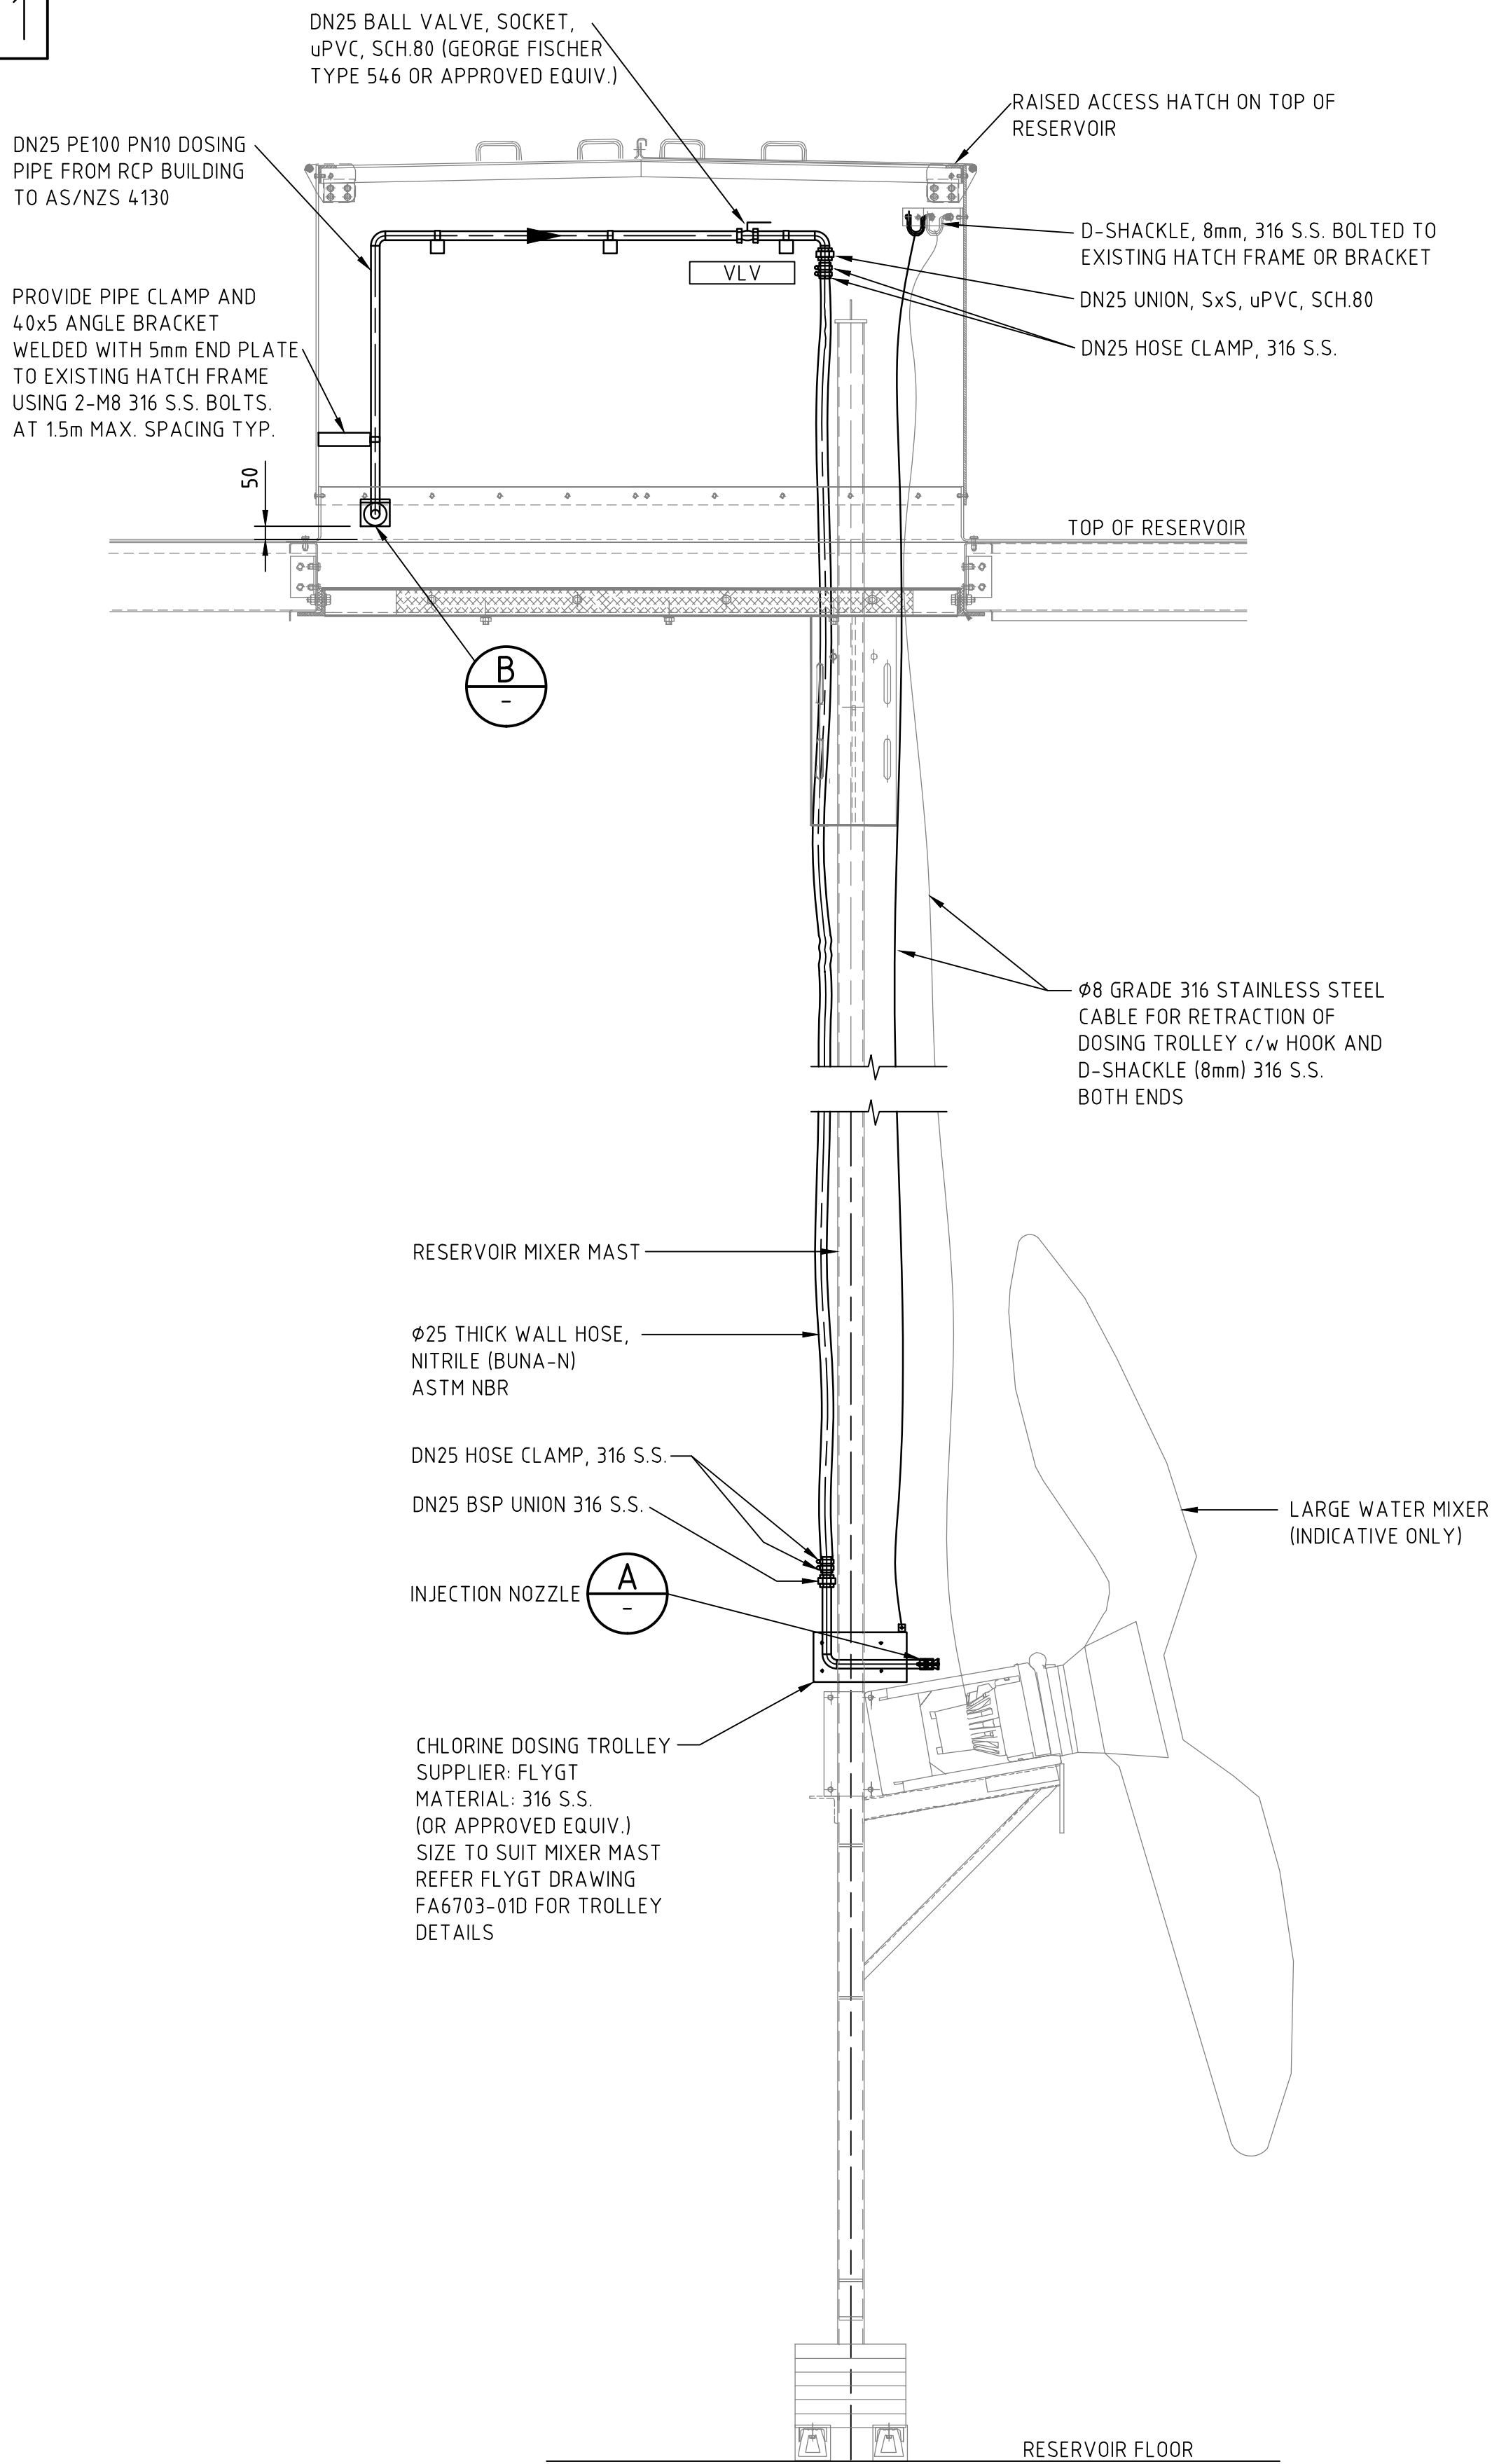


DOSING POINT TYPE 1 (RESERVOIR)

SCALE 1:20


NOTES:

1. FOR GENERAL NOTES REFER TO DRG No. DTC-7002.
2. ALL MATERIAL TO BE STAINLESS STEEL, GRADE 316 U.N.O.
3. HATCH SIZE MAY VARY.
4. DETAIL OF MATERIAL, VALVE & PROPRIETARY PRODUCTS PROVIDED HOWEVER LAYOUT AND SIZES (INCLUDING PIPE SIZES) MAY VARY DUE TO SITE SPECIFIC INSTALLATION.

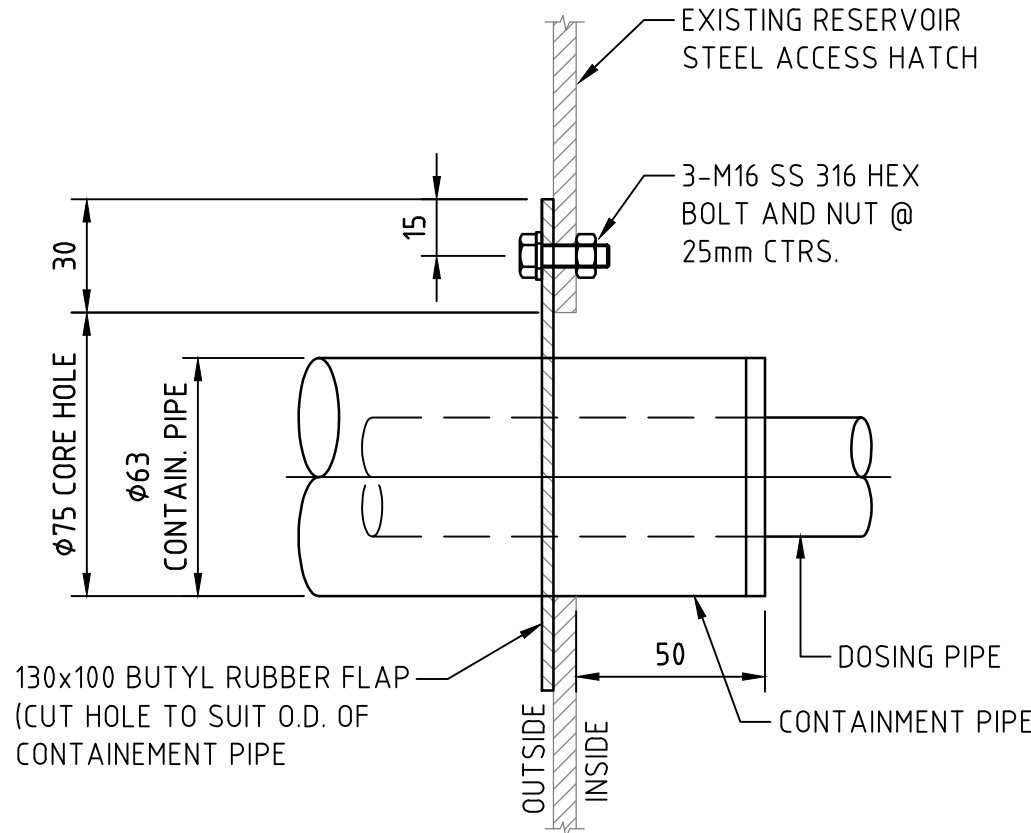

DETAIL B - DOSING PIPE PENETRATION THROUGH EXISTING HATCH


SCALE 1:2

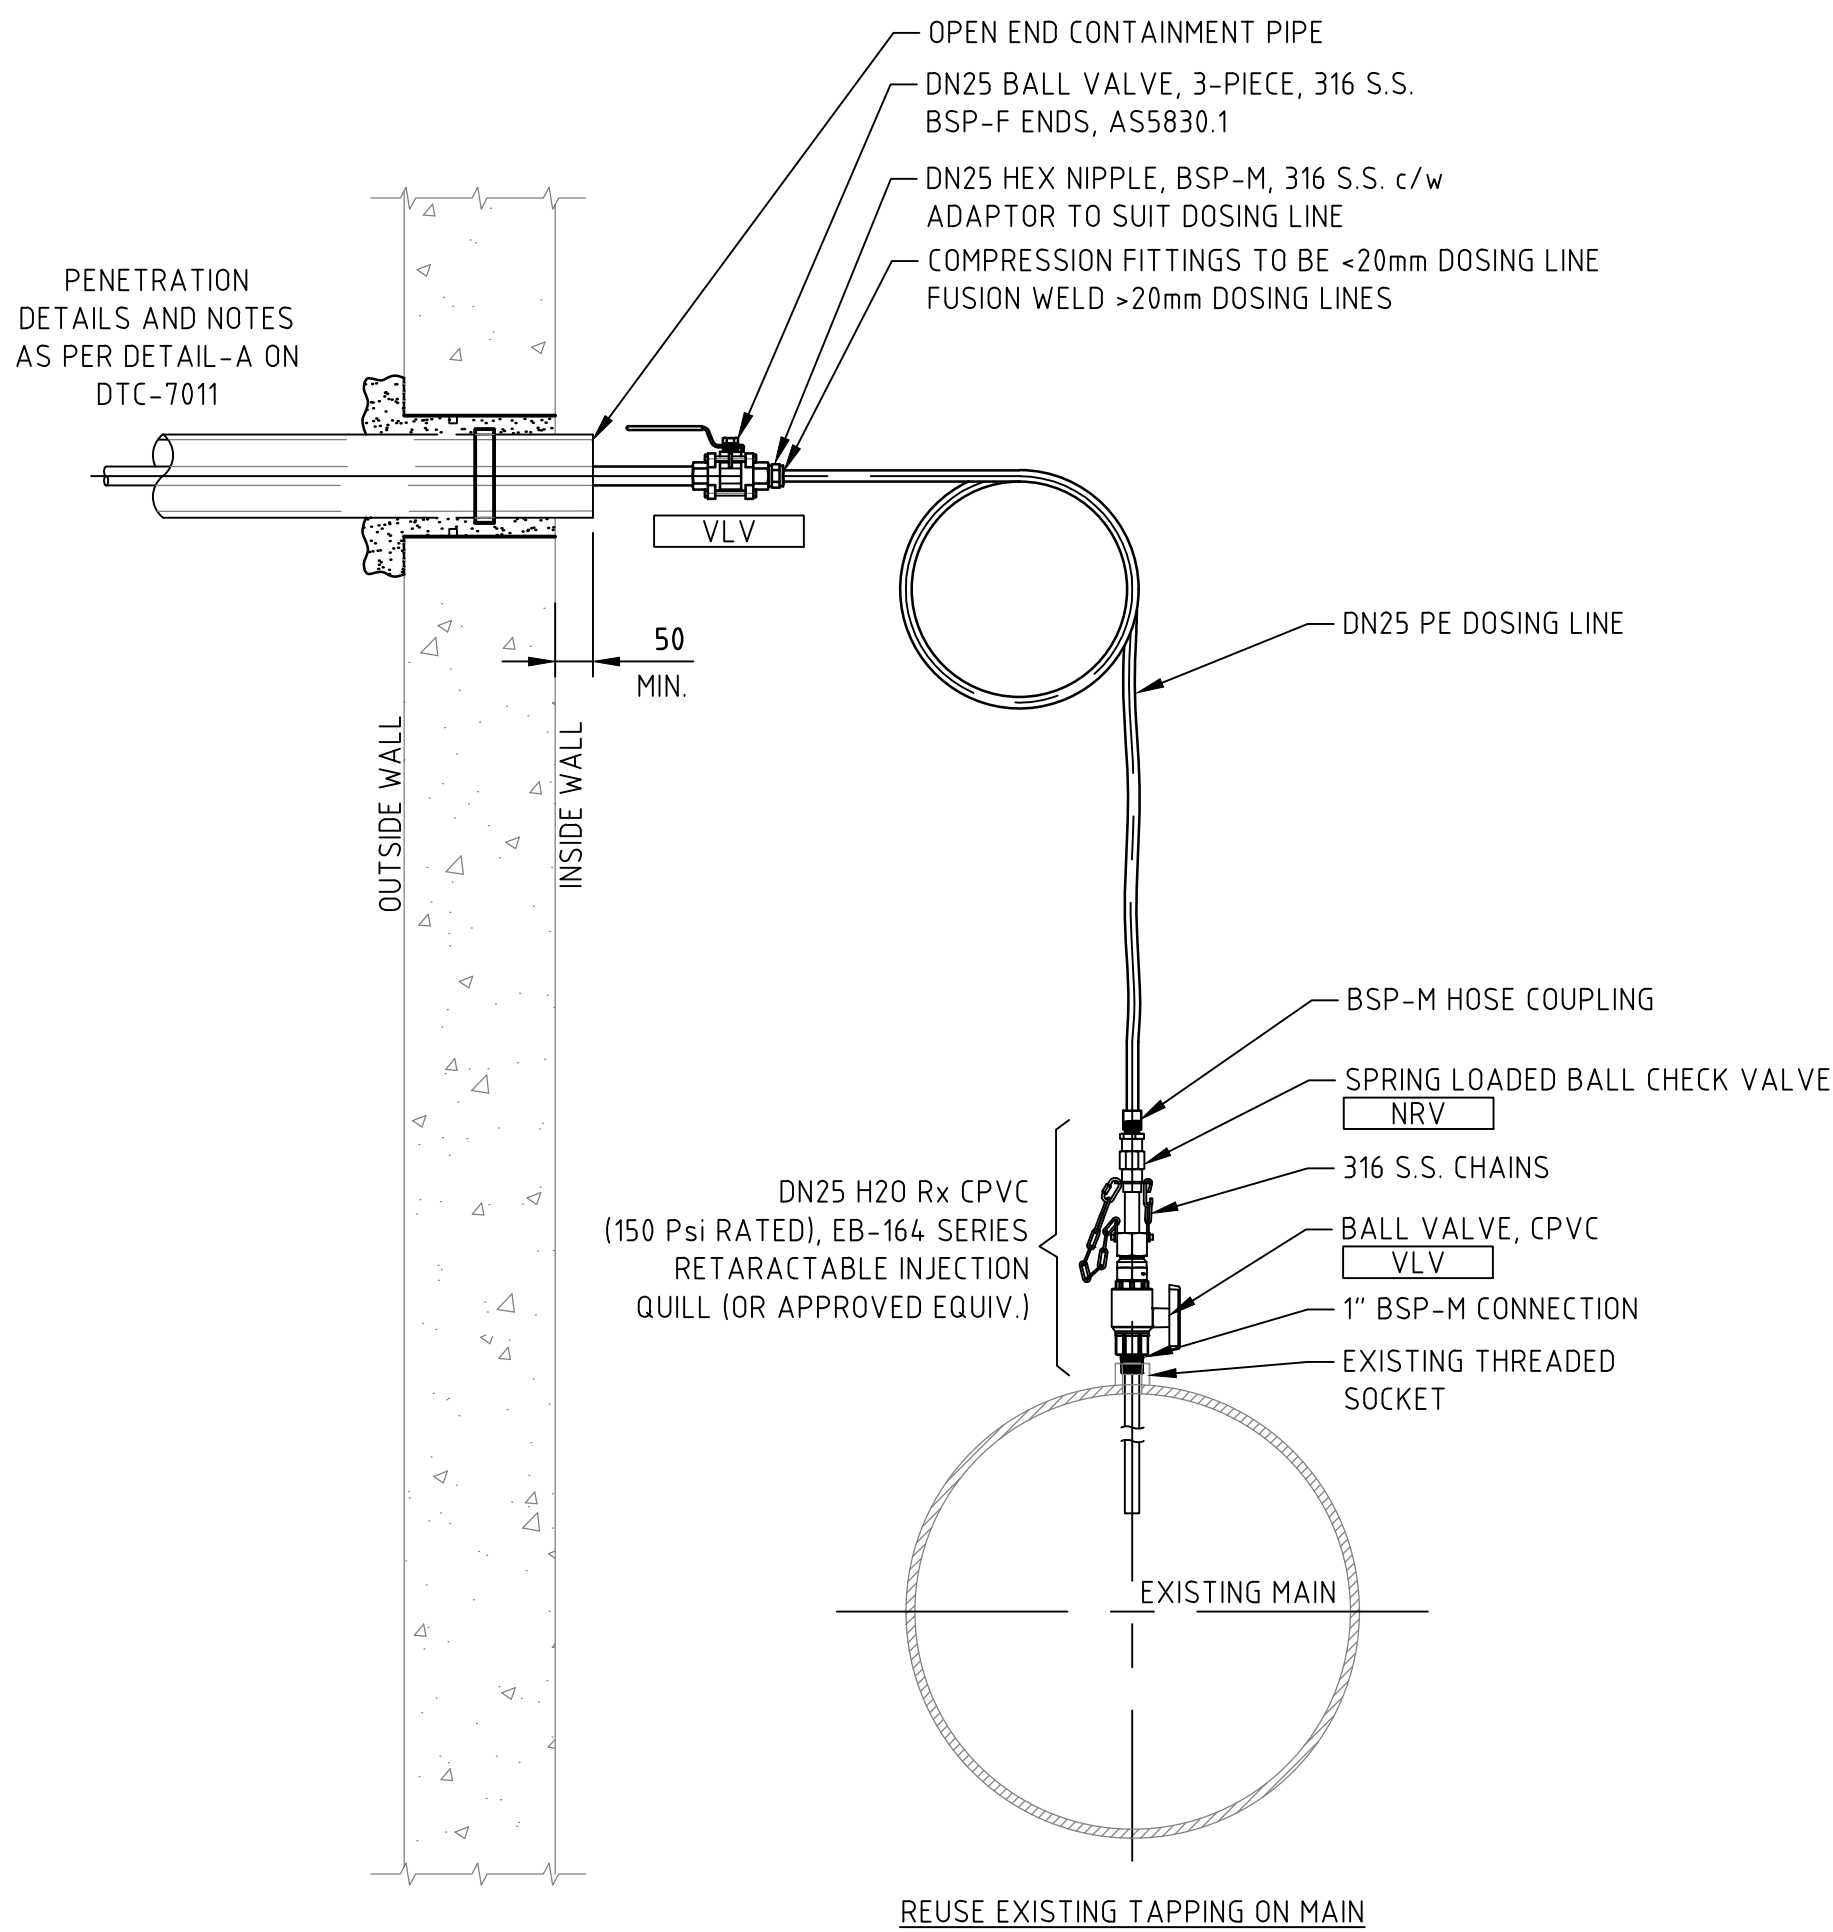


DOSING POINT TYPE 2 (WATER MAIN INSIDE PIT)

SCALE NTS

THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS. USE THIS DRAWING WITH CARE. YOU ARE RESPONSIBLE TO APPLY THE WORK SHOWN IN THIS DRAWING CORRECTLY IN THE CIRCUMSTANCES OF YOUR PROJECT. YOU MUST ENSURE THE WORK IS FIT FOR PURPOSE AND WILL PERFORM ITS INTENDED FUNCTION AS REQUIRED.

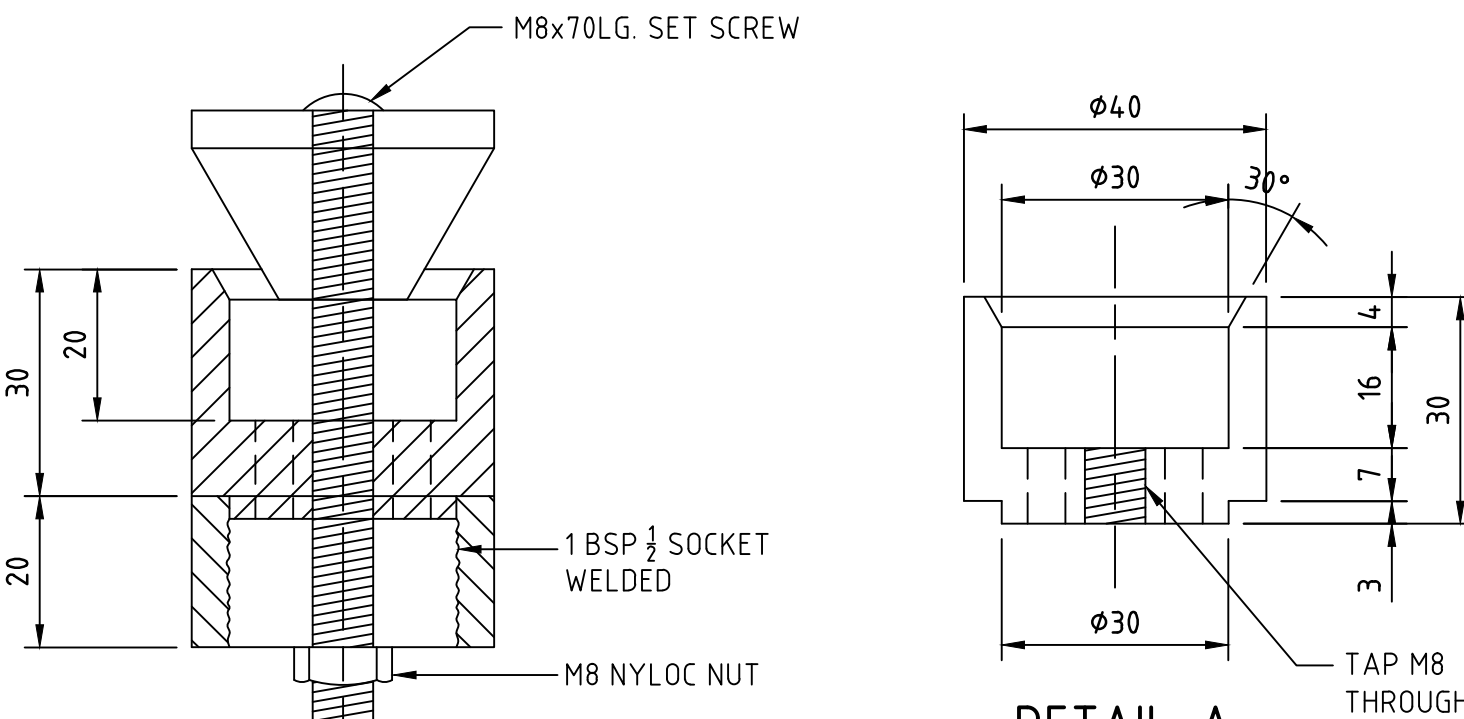

NOZZLE ASSEMBLY SECTION

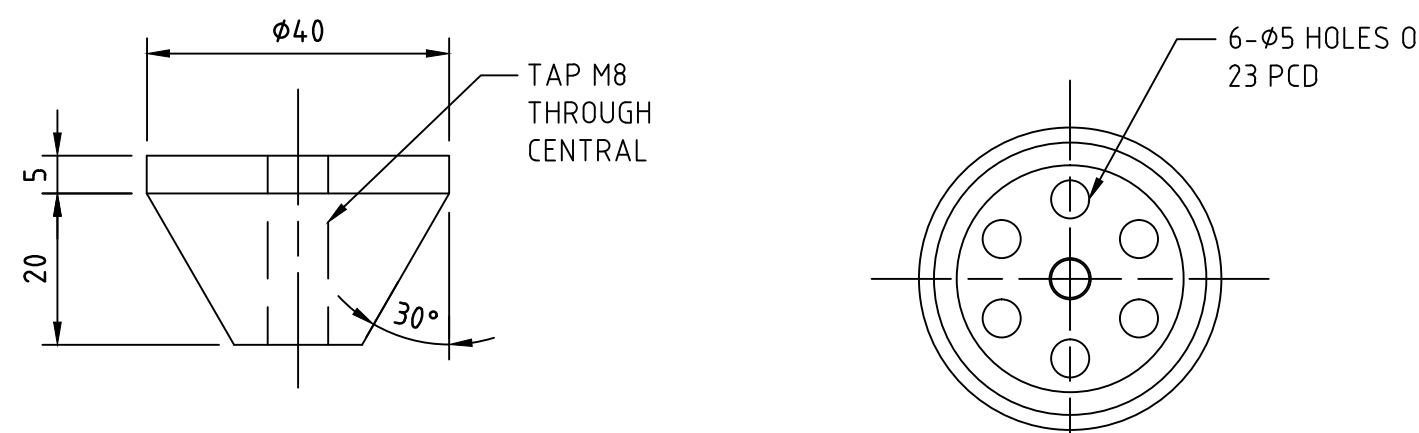


NOZZLE ELEVATION

NOZZLE ASSEMBLY PLAN

DETAIL A - INJECTION NOZZLE DETAIL

SCALE 1:1

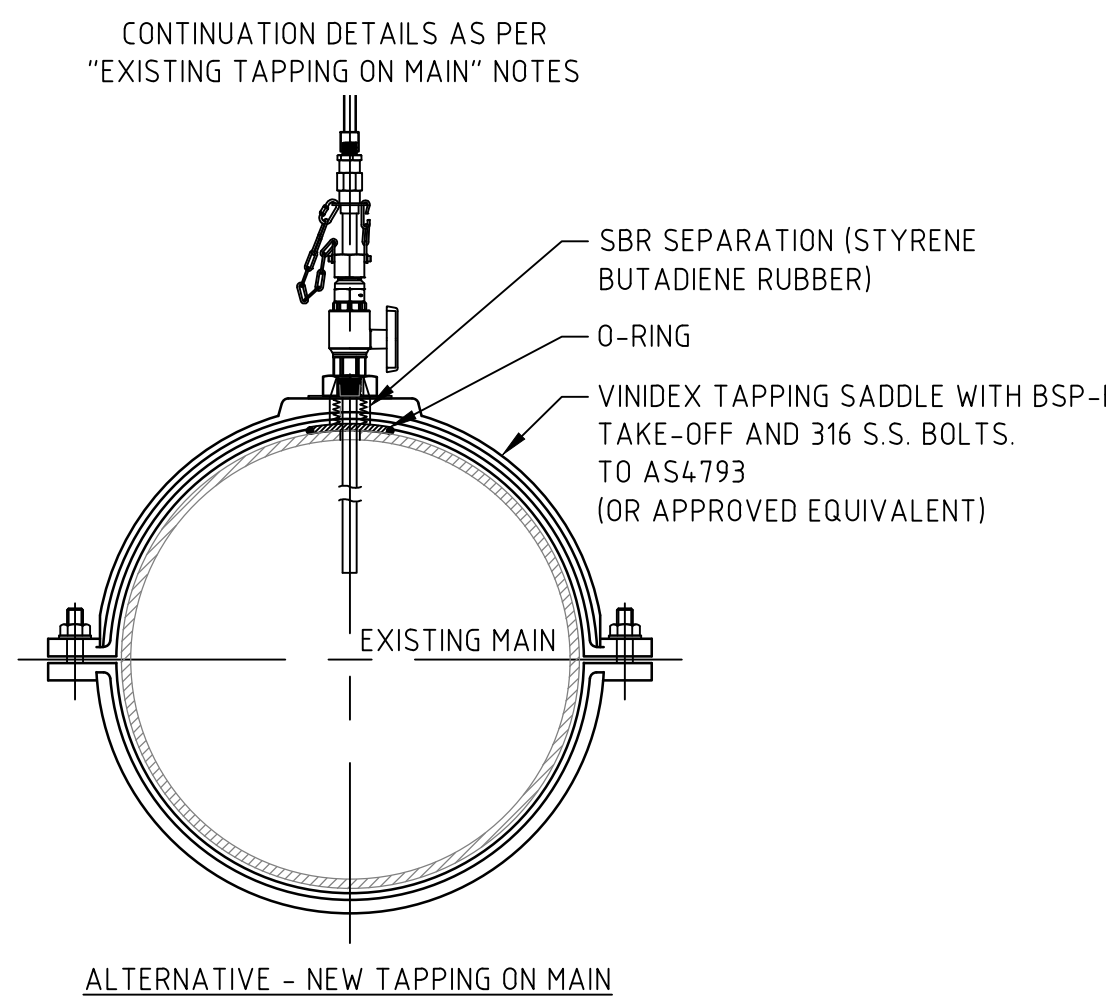

Sydney
WATER

©COPYRIGHT
STATE OF NEW SOUTH WALES THROUGH SYDNEY
WATER CORPORATION. ALL RIGHTS RESERVED

APPROVED MAR 2017

KEN WIGGINS
MANAGER, E & ES

ENGINEERING & ENVIRONMENTAL SERVICES

A

ORIGINAL ISSUE

LETTER

DETAILS OF AMENDMENT

KW

17/03/17

APP'D

DATE

DEEMED TO COMPLY DRAWINGS

TYPICAL RECHLORINATION PLANT
SODIUM HYPOCHLORITE
DOSING POINT DETAILS

DTC

7014