


A1

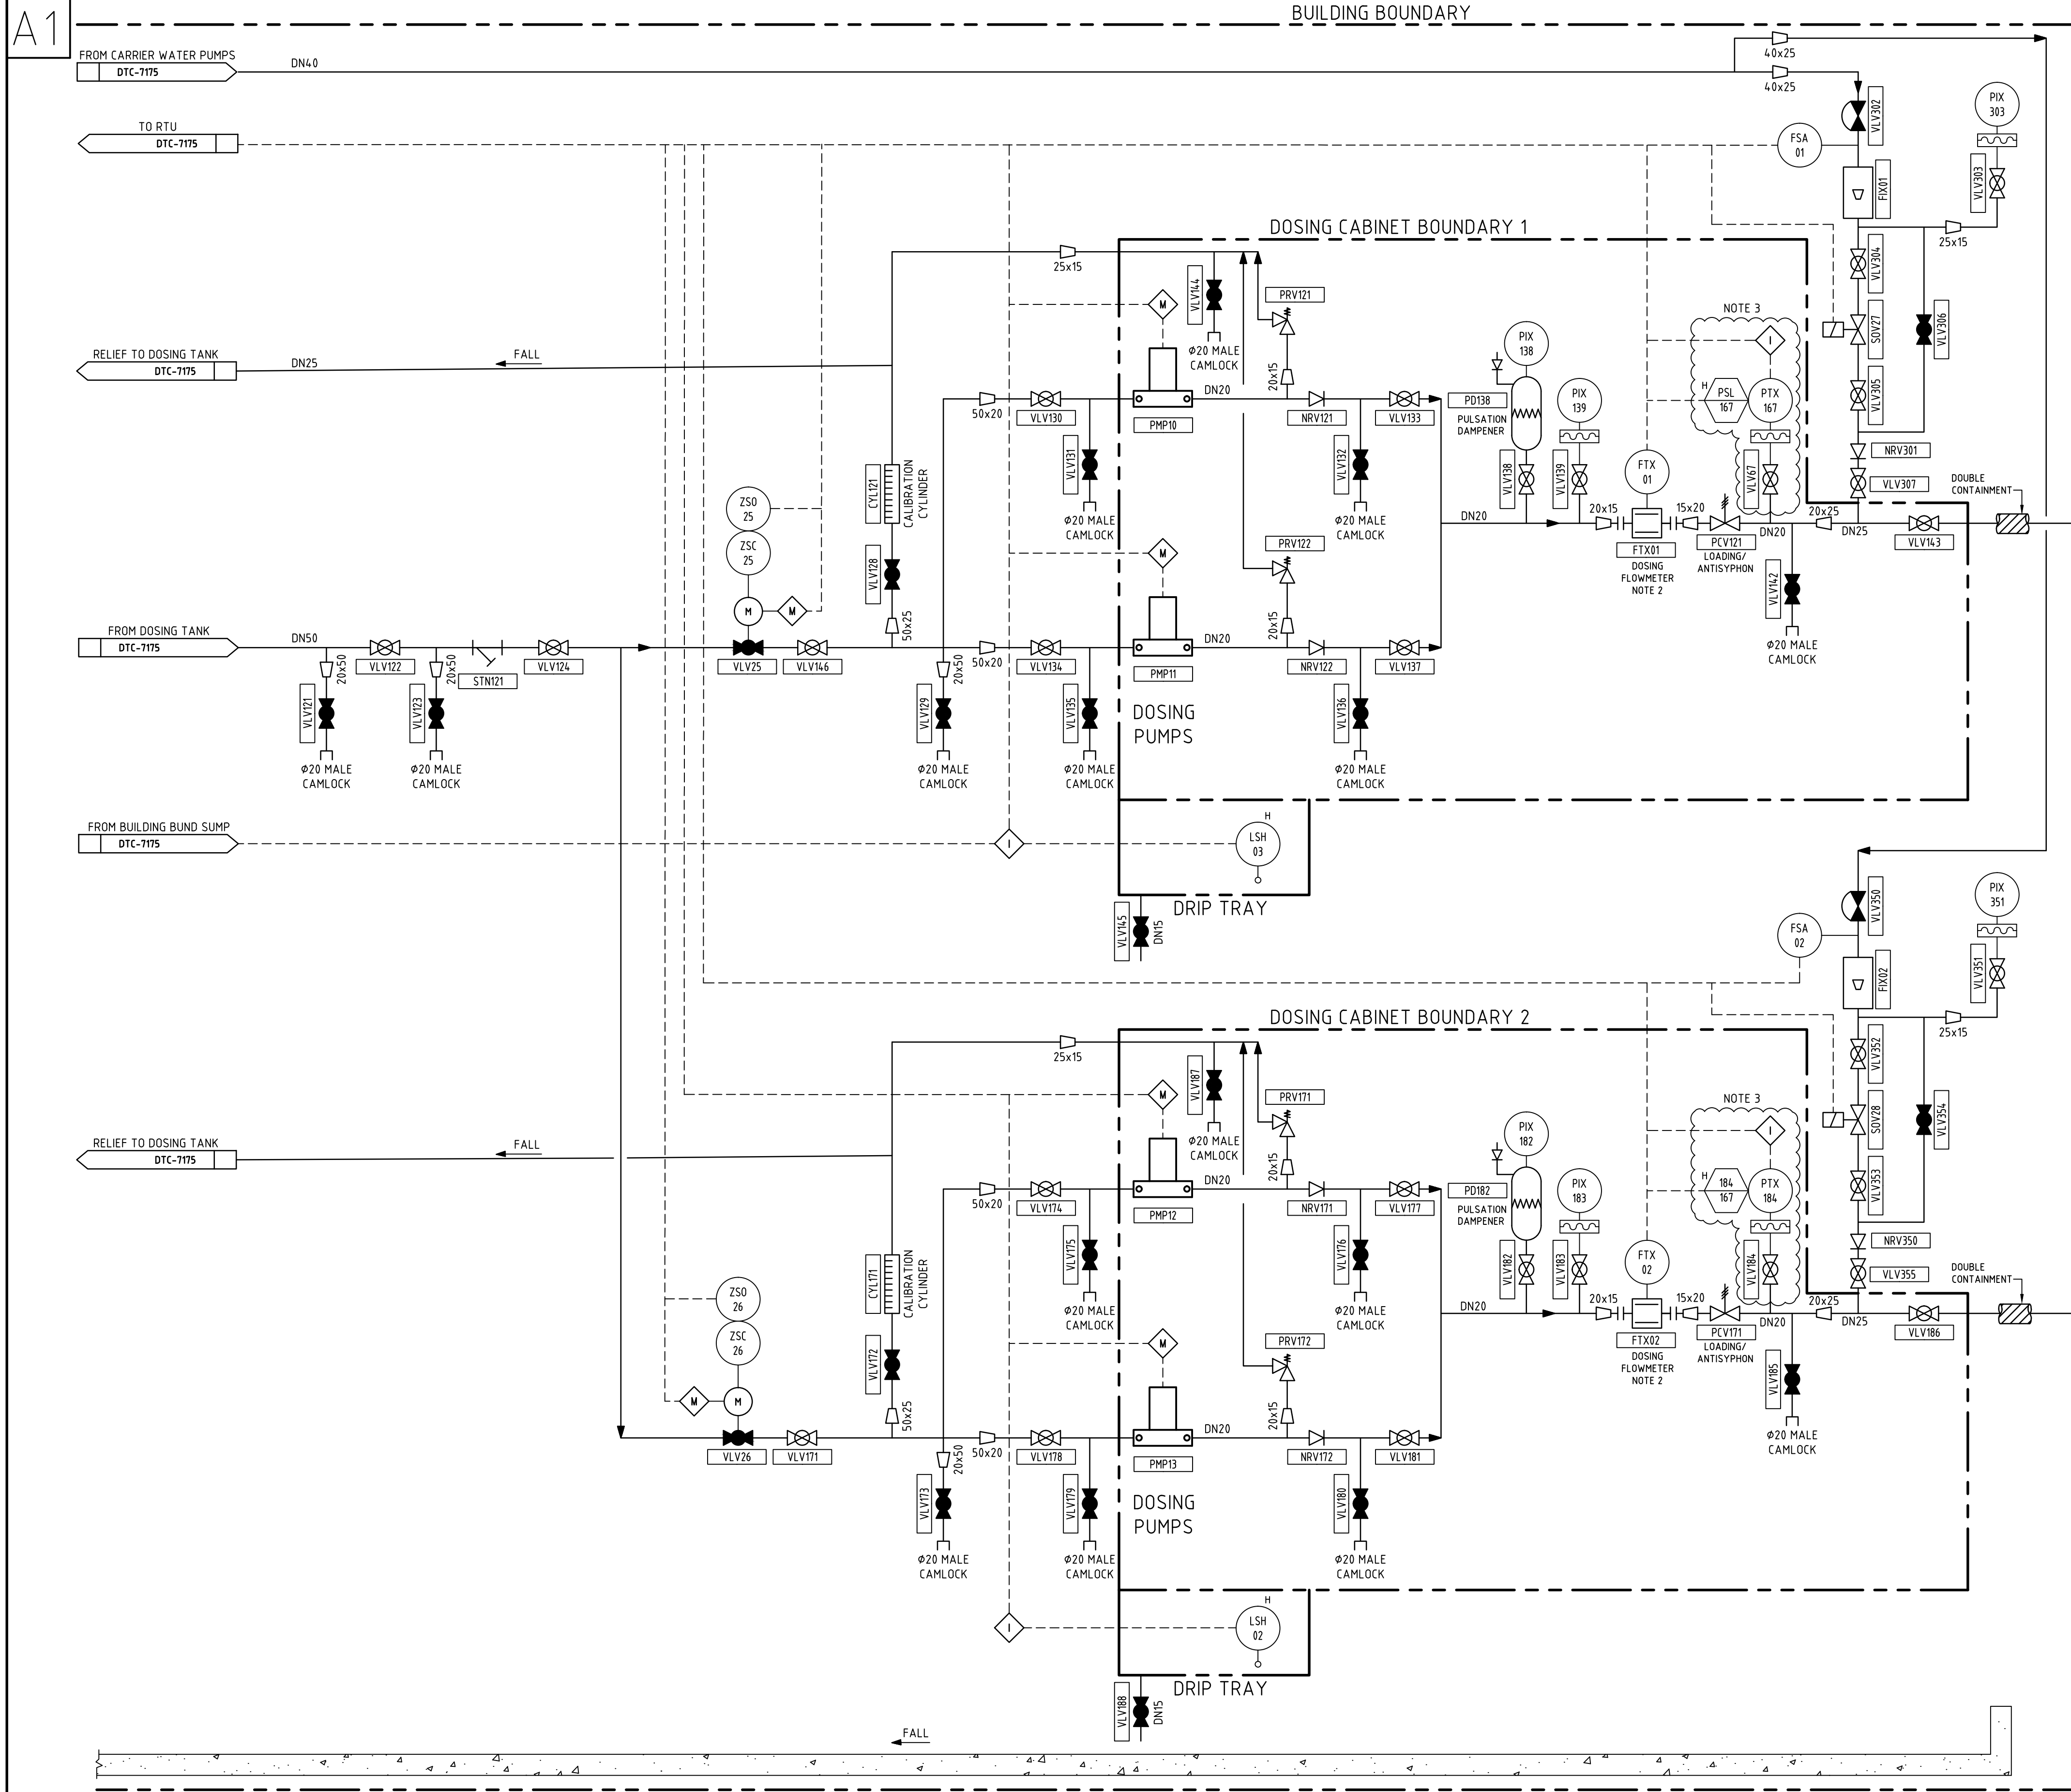

THIS DRAWING MAY ONLY BE USED IN THE COURSE OF AND FOR THE PURPOSE OF CREATING SYDNEY WATER ASSETS. USE THIS DRAWING WITH CARE. YOU ARE RESPONSIBLE TO APPLY THE WORK SHOWN IN THIS DRAWING CORRECTLY IN THE CIRCUMSTANCES OF YOUR PROJECT. YOU MUST ENSURE THE WORK IS FIT FOR PURPOSE AND WILL PERFORM ITS INTENDED FUNCTION AS REQUIRED.

NOTES:

- FOR GENERAL NOTES REFER TO DRG No. DTC-7002.
- SPOOL PIECE TO BE SUPPLIED FOR REMOVAL OF FLOWMETER.
- PTX REQUIRED FOR MAINS DOSING ONLY.

REFERENCE DRAWINGS

DTC-7018 P&ID LINE LEGEND & INSTRUMENTATION SYMBOLS.
DTC-7019 P&ID PREFIXES AND PIPING CODES.
DTC-7020 P&ID LEGEND SYMBOLS SHEET.

<div>Sydney</div> <div>WATER</div>	APPROVED	MAR 2017					DEEMED TO COMPLY DRAWINGS		<div>DTC</div> <div>7176</div>
	<div>KEN WIGGINS</div> <div>MANAGER, E & ES</div>	13.5kL + 13.5kL RECHLORINATION PLANT SODIUM HYPOCHLORITE P&ID - SHEET 2 OF 2							
<div>©COPYRIGHT</div> <div>STATE OF NEW SOUTH WALES THROUGH SYDNEY WATER CORPORATION. ALL RIGHTS RESERVED</div>	ENGINEERING & ENVIRONMENTAL SERVICES	A	ORIGINAL ISSUE	KW	13/03/17				
		LETTER	DETAILS OF AMENDMENT	APP'D	DATE				